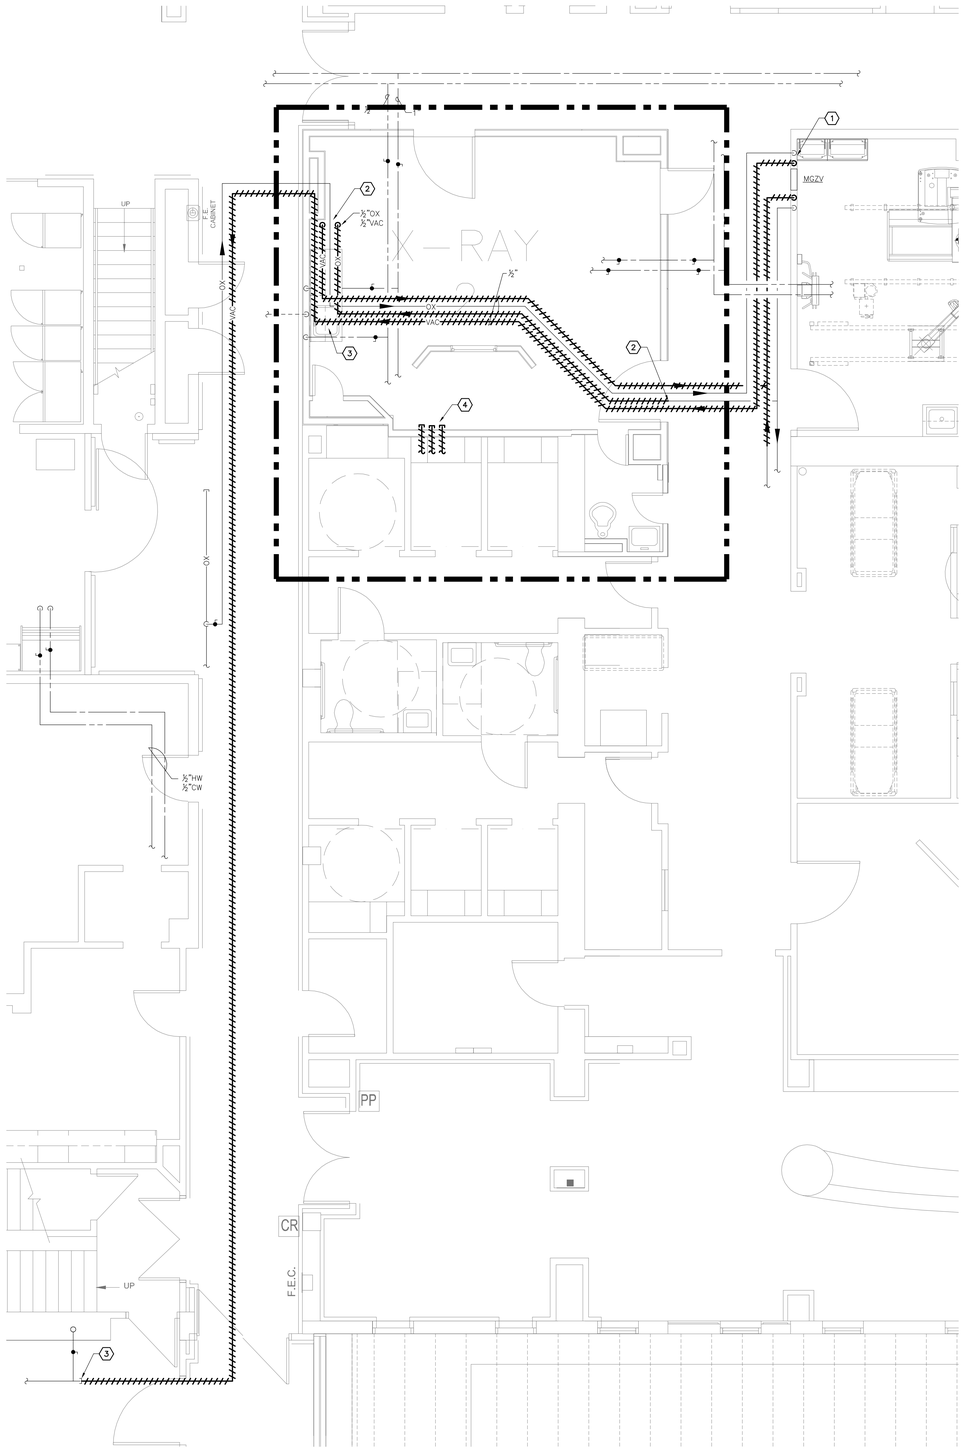


## XRAY-2 ROOM DEMOLITION PART PLAN

SCALE: 1/4"=1'-0"

PLUMBING DEMOLITION NOTES:

1. EXISTING ½"MEDICAL VACUUM LINES TO BE RETRACTED BACK TO ZONE VALVE (INCLUDING DROPS TO ZONE VALVE). PREPARE FOR NEW CONNECTION TO ZONE VALVE WITH ¾"LINE.
2. RETRACT MEDICAL GAS TO POINT SHOWN ON PLANS AND PREPARE FOR NEW CONNECTION. REMOVE MEDICAL GAS OUTLETS AND PROVIDE NEW.
3. RETRACT ½"MEDICAL VACUUM LINE BACK TO MAIN AND PREPARE FOR NEW CONNECTION. ROUTE NEW ¾"VACUUM LINE TO EXISTING ZONE VALVE.
4. REMOVE ABANDONED HW, CW, WASTE AND VENT PIPING BACK TO MAIN AND CAP.

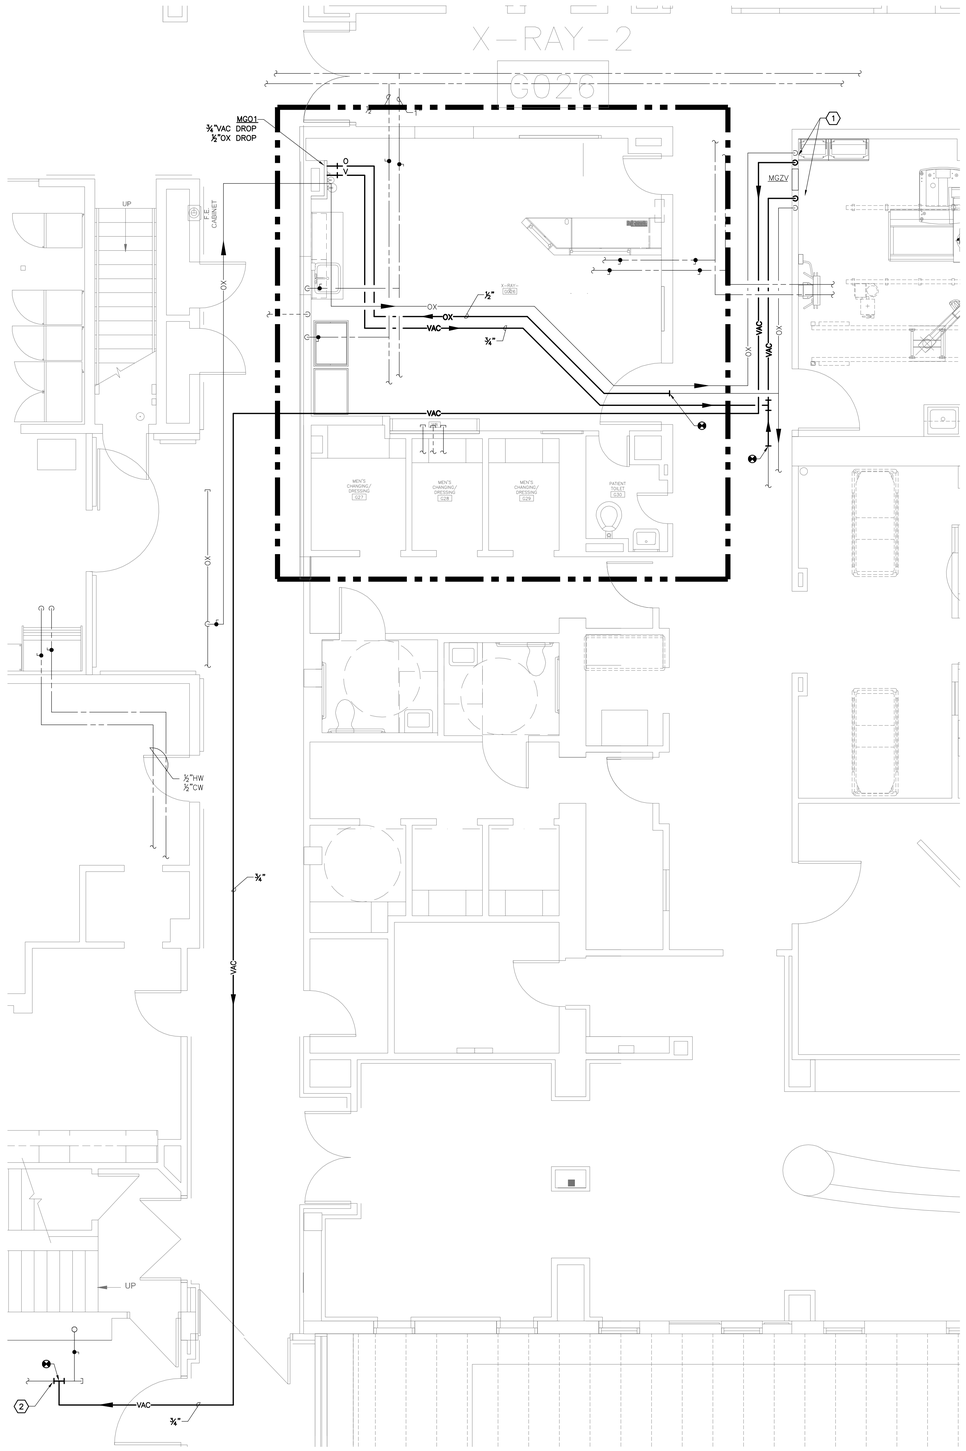


## XRAY-2 ROOM NEW WORK PART PLAN

SCALE: 1/4"=1'-0"

PLUMBING NEW WORK NOTES:

1. DROP IN WALL WITH NEW ¾" VACUUM LINE AND CONNECT TO EXISTING ¾" MEDICAL GAS ZONE VALVE.
2. CONNECT TO EXISTING VACUUM MAIN AT LOCATION SHOWN ON PLANS. PRIOR TO CONNECTION, CONFIRM SIZE AND REPORT INFORMATION TO ENGINEER.


ARCHITECTS STEFFIAN BRADLEY sba

Steffian Bradley Architects
100 Summer Street
Boston, MA 02110.2106
T 617.305.7100 F 617.305.7199
www.steffian.com


Notes

Baystate Franklin Medical Center


RDK ENGINEERS

Richard D. Kimball Company, Inc
200 Brickstone Square
Andover, MA 01810-1488


Key Plan



Seal

BAYSTATE FRANKLIN MEDICAL CENTER

CT-2 & X-RAY 2 INSTALLATION PROJECT

| Project Number | Scale |
|---|---|
| 02164.000 | 1/4"=1'-0" |
| **Date** | **Issue** |
| 12/08/11 | ISSUED FOR BID |

Title

PLUMBING
XRAY-2 ROOM
PART PLANS

# P1.2


J:\2011\2011010358 - BIDMC Franklin Cnt Radiology Department Upgrade\Plumbing\2011010358_P1.2_XRAY_PART PLANS.dwg [30x42] December 08, 2011 - 9:06am aaskin