

Roy S. Brown Architects

85 Chilson Road ~ Wilbraham, Massachusetts 01095

phone 596-2360 ~ fax 596-2360

email rsba85@yahoo.com

Steeple Reconstruction
Unitarian Universalist Parish of Monson
177 Main Street
Monson, Ma 01057

Project No. 12-02-03

Addendum No. 03


February 20, 2012

- A. This addendum shall amend and supplement the information in the Bid Documents.**
- B. Bidders shall agree to be bound by the following terms and conditions.**

Items:

1. The General Bid is hereby extended until Friday, February 24, 2012 at 2 p.m. at the office of Roy S. Brown Architects.
2. The General Contractor is responsible for the replacement of the lightning protection system that was destroyed. The lightning protection system is required to run from the topmost part of the new steeple down to the ground, and be properly grounded. The new steel pipe guardrails at the fifth floor are to be tied into the lightning protection system as well.
3. The bidding documents are hereby amended according to the attached sketch SK.4.

- End of Addendum -

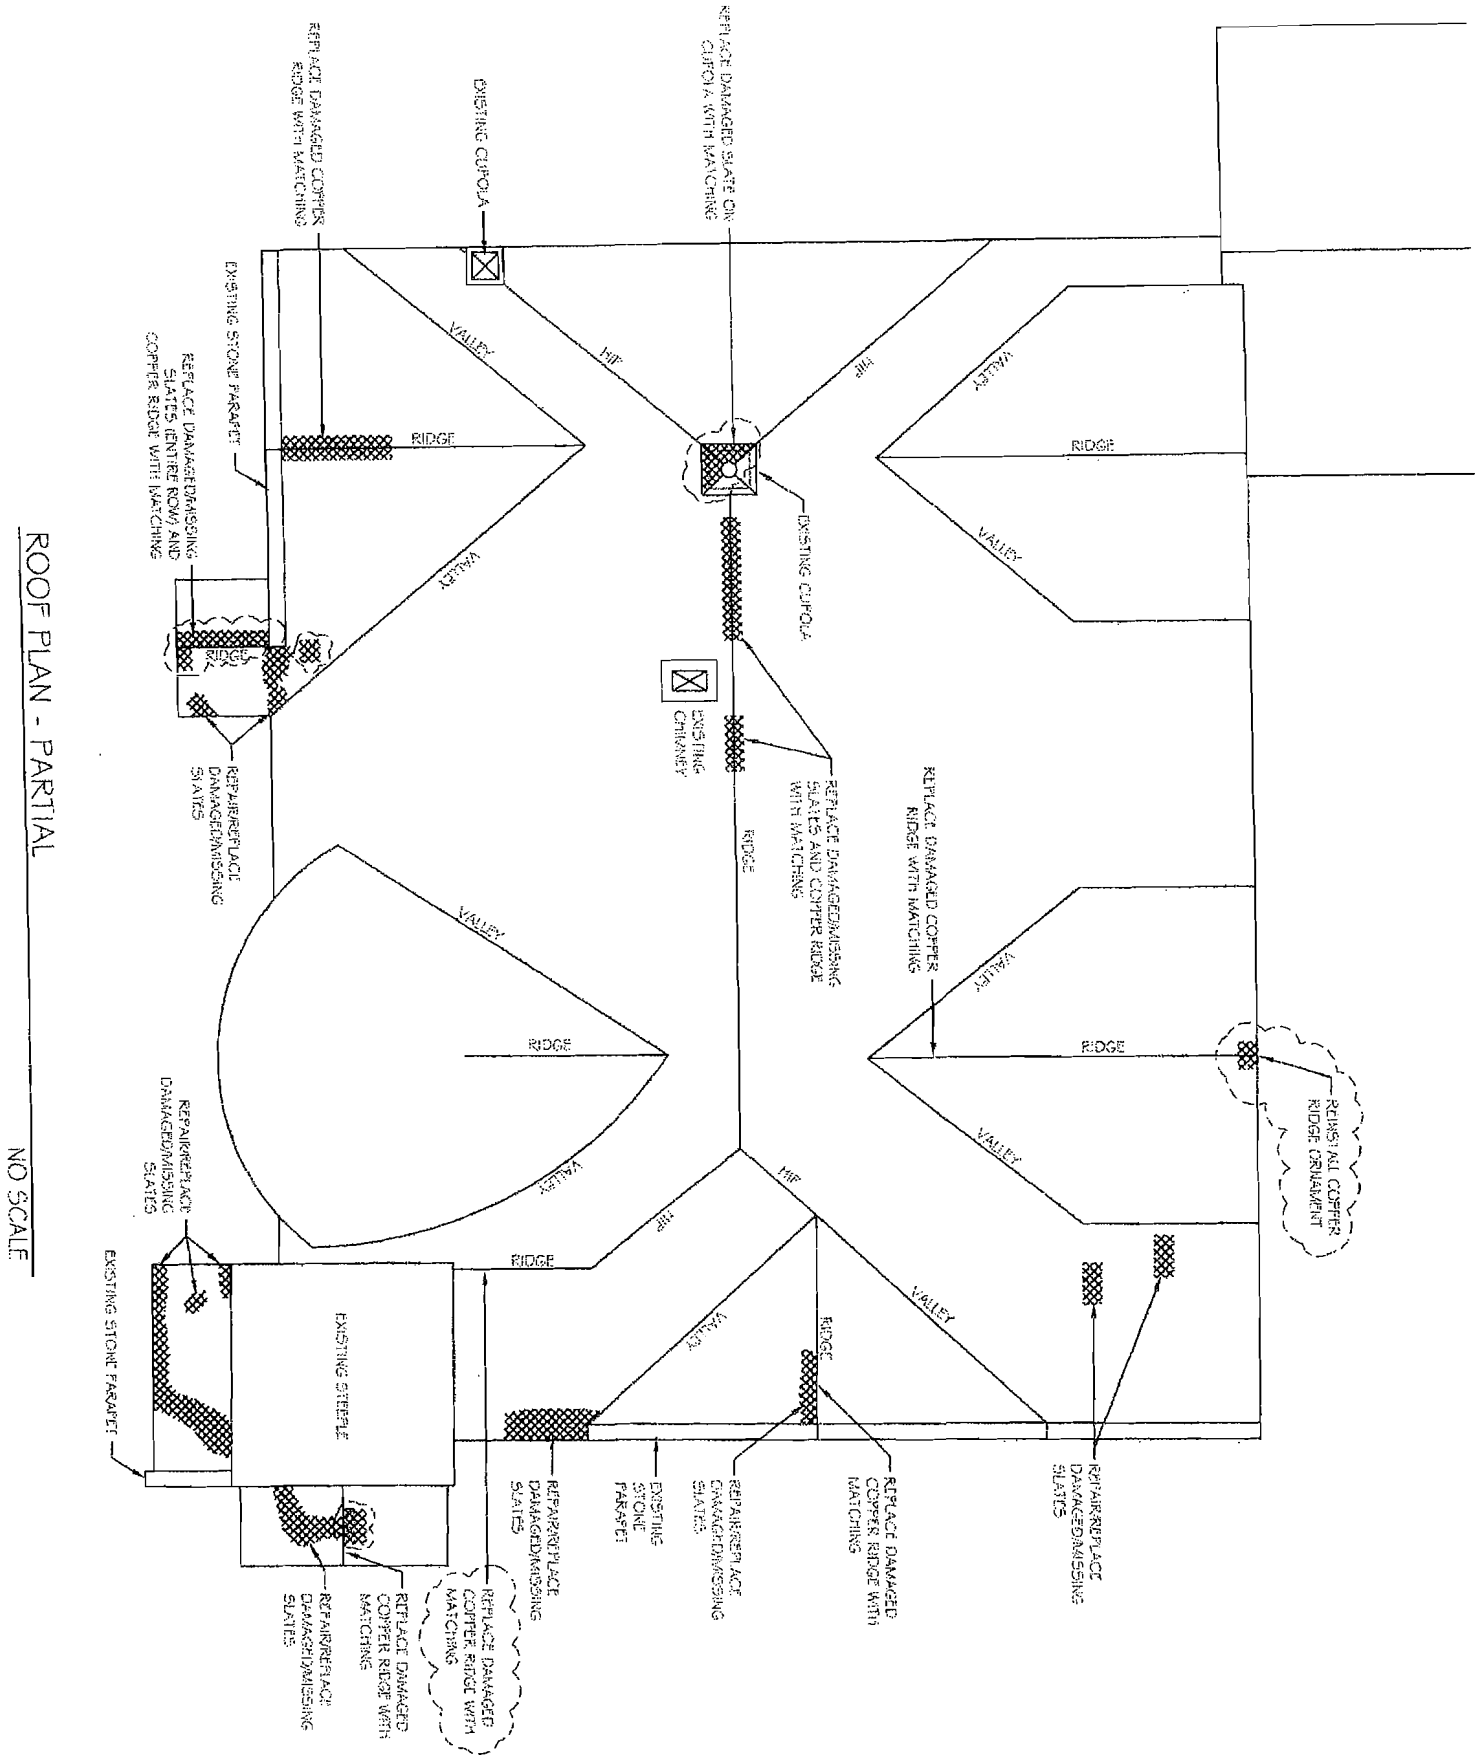

ROOF PLAN - PARTIAL

NO SCALE

SK.4

STEEPLE RECONSTRUCTION
 MONSON UNITARIAN UNIVERSALIST CHURCH
 177 MAIN STREET
 MONSON, MA 01057

DATE	REVISIONS	DATE	CHECK
02.20.12			VRB
12-02-03			RSB

DATE: 02.20.12
 PROJECT No. 12-02-03

ROY S. BROWN ARCHITECTS
 85 CHILSON ROAD
 WILBRAHAM, MA 01085
 PH 413.596.2360
 FAX 413.596.2360