



- NOTES:**
- VAPOR-TIGHT EXTERIOR LIGHT FIXTURE AS MANUFACTURED BY LUMARK CATALOG. PH-6 VS-W-66-42 UNV-GREY-LL WITH (1) 42W CFC42W LONG LIFE FLUORESCENT LAMP (10,000 HOUR LAMP) (INPUT WATTS 48)
 - DISCONNECT SWITCH SHALL BE MOUNTED ON UNISTRUT LOCATED NO GREATER THAN 5'-0" ABOVE ROOF LEVEL. COORDINATE EXACT LOCATION OF DISCONNECT SWITCH WITH ENGINEER IN THE FIELD.

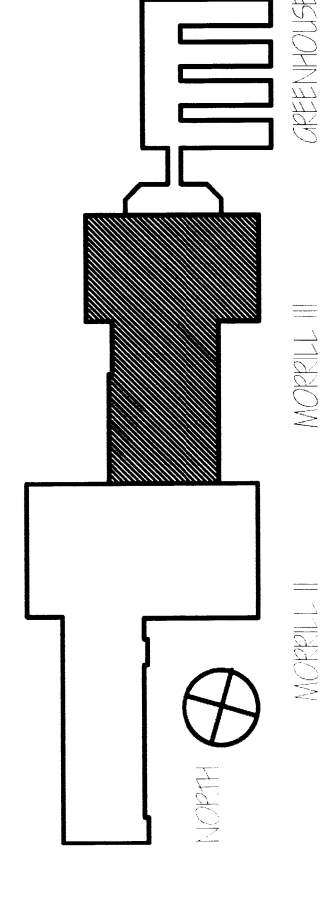

BUILDING KEY PLAN
NOT TO SCALE

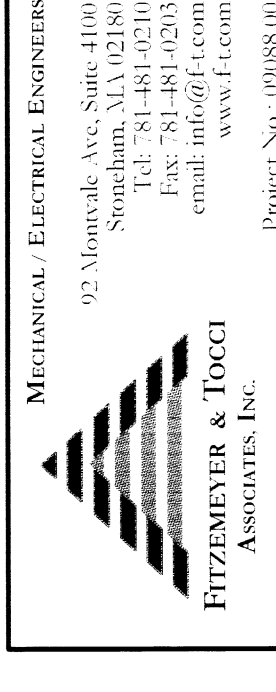

REV NO	DESCRIPTION	BY	APPD	DATE
-	ISSUED FOR BID	-	-	08-25-10
-	100% CONSTRUCTION DOCUMENTS	-	-	08-20-10

UNIVERSITY OF MASSACHUSETTS FACILITIES PLANNING DIVISION MORRILL II & III VENTILATION UPGRADE		BY	DATE	PROJECT NO.	CONTRACT NO.
		DRN	-	UMA 09088	UMA 1104
APPD	-	SCALE	1/8" = 1'-0"	SHEET	71
CMD	-	DRAWING NUMBER	-	-	-
APPD	-	D-A-127290-08-001594-	E12	-	-