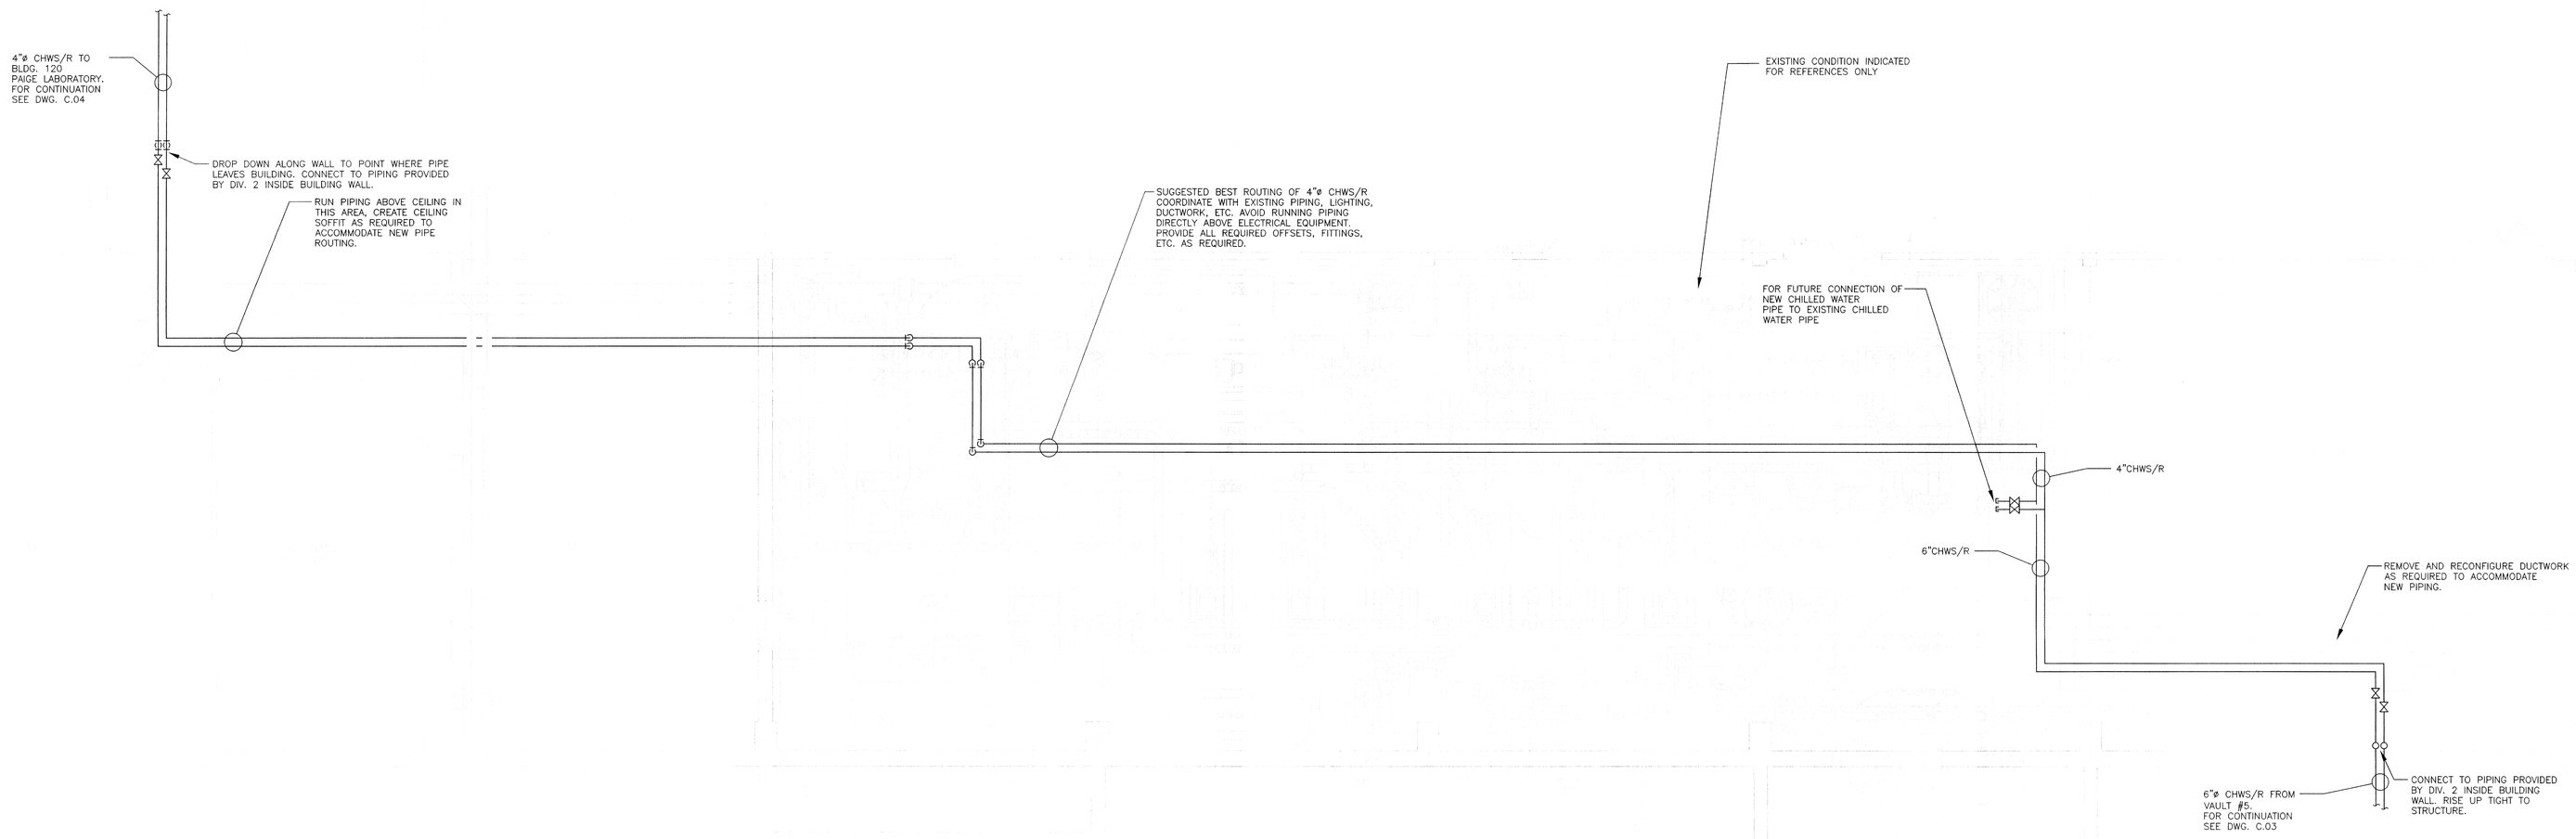

BASEMENT & MECH. ROOM CHWS/R PIPING PLAN

SCALE: 1/4"=1'-0"

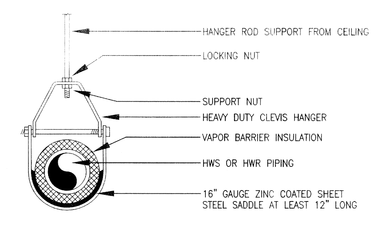

CHILLED WATER PIPE HANGER DETAIL

NOT TO SCALE

NOTES:
1. WORK ON THIS PLAN IS INCLUDED IN ALT. #1.
2. EXISTING CONDITION INDICATED FOR REFERENCES ONLY. CONTRACTOR SHALL VERIFY EXISTING CONDITION AT SITE.
3. PROVIDE COORDINATION DRAWINGS FOR ALL PIPE ROUTING WITHIN BUILDING SHOWING EXISTING CONDITIONS AND CLEARANCES TO ALL EQUIPMENT, PIPING, DUCTWORK, ETC. TO MAINTAIN SERVICE CLEARANCES.

PLAN NORTH

GRAPHIC SCALE

(IN FEET)

12/22/2011

DIVERSIFIED TECHNOLOGY CONSULTANTS
2321 WHITNEY AVENUE HAMDEN CT 06518
203.239.4200 203.234.7376 FAX
305 N. MAIN STREET SUITE 202 ANDOVER MA 01810
978.475.2935 978.475.2936 FAX

NO.		BY.	APP'D	DATE
1	ADDENDUM #01	A.M.	H.K.	12/22/11

UNIVERSITY OF MASSACHUSETTS
FACILITIES PLANNING DIVISION

UTILITIES, NORTHWEST
CHILLED WATER LOOP PHASE 1
KNOWLES - MECHANICAL PIPING PLAN

DRN.	HHK	12/22/11	PROJECT NO. UMA II-000607-01	CONTRACT NO. UMA 12-20
APP'D	HK	12/22/11	SCALE AS NOTED	SHEET 13 OF 20
CKD.	MAS	12/22/11	DRAWING NUMBER	M.01
APP'D	MJC	12/22/11		

BID DOCUMENTS 11/18/11